

000007 2206960

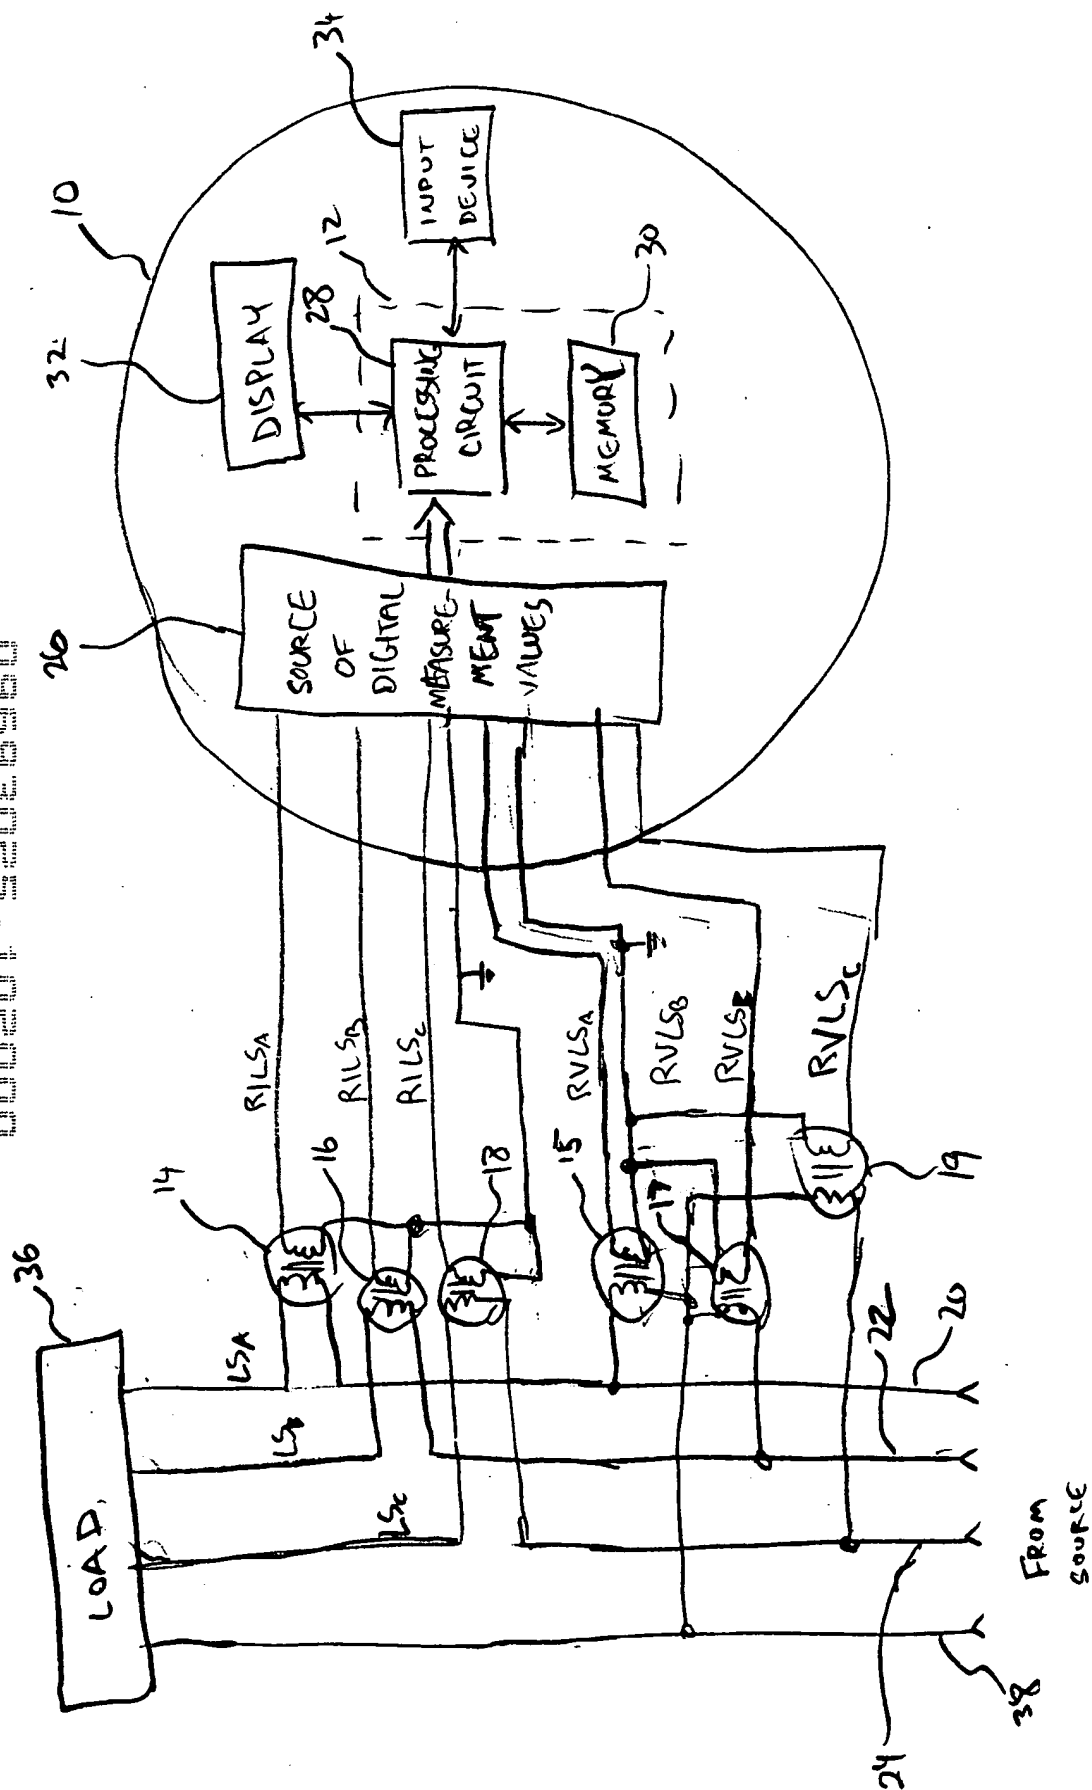


FIG. 1

000001-000000

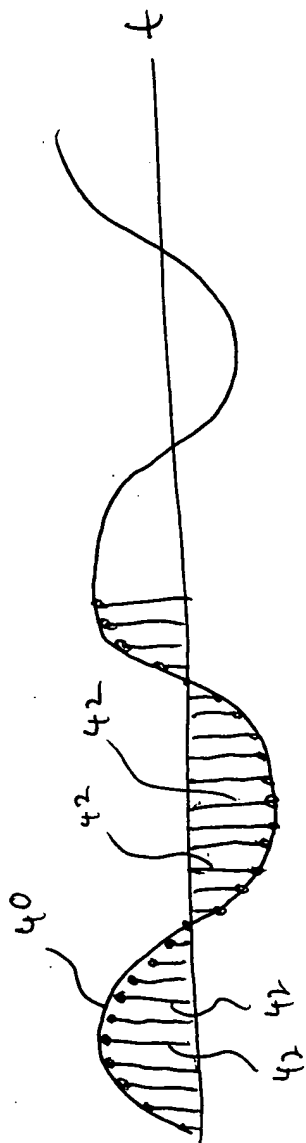


Fig. 2

Current Channel Inst. Xfmr Correction

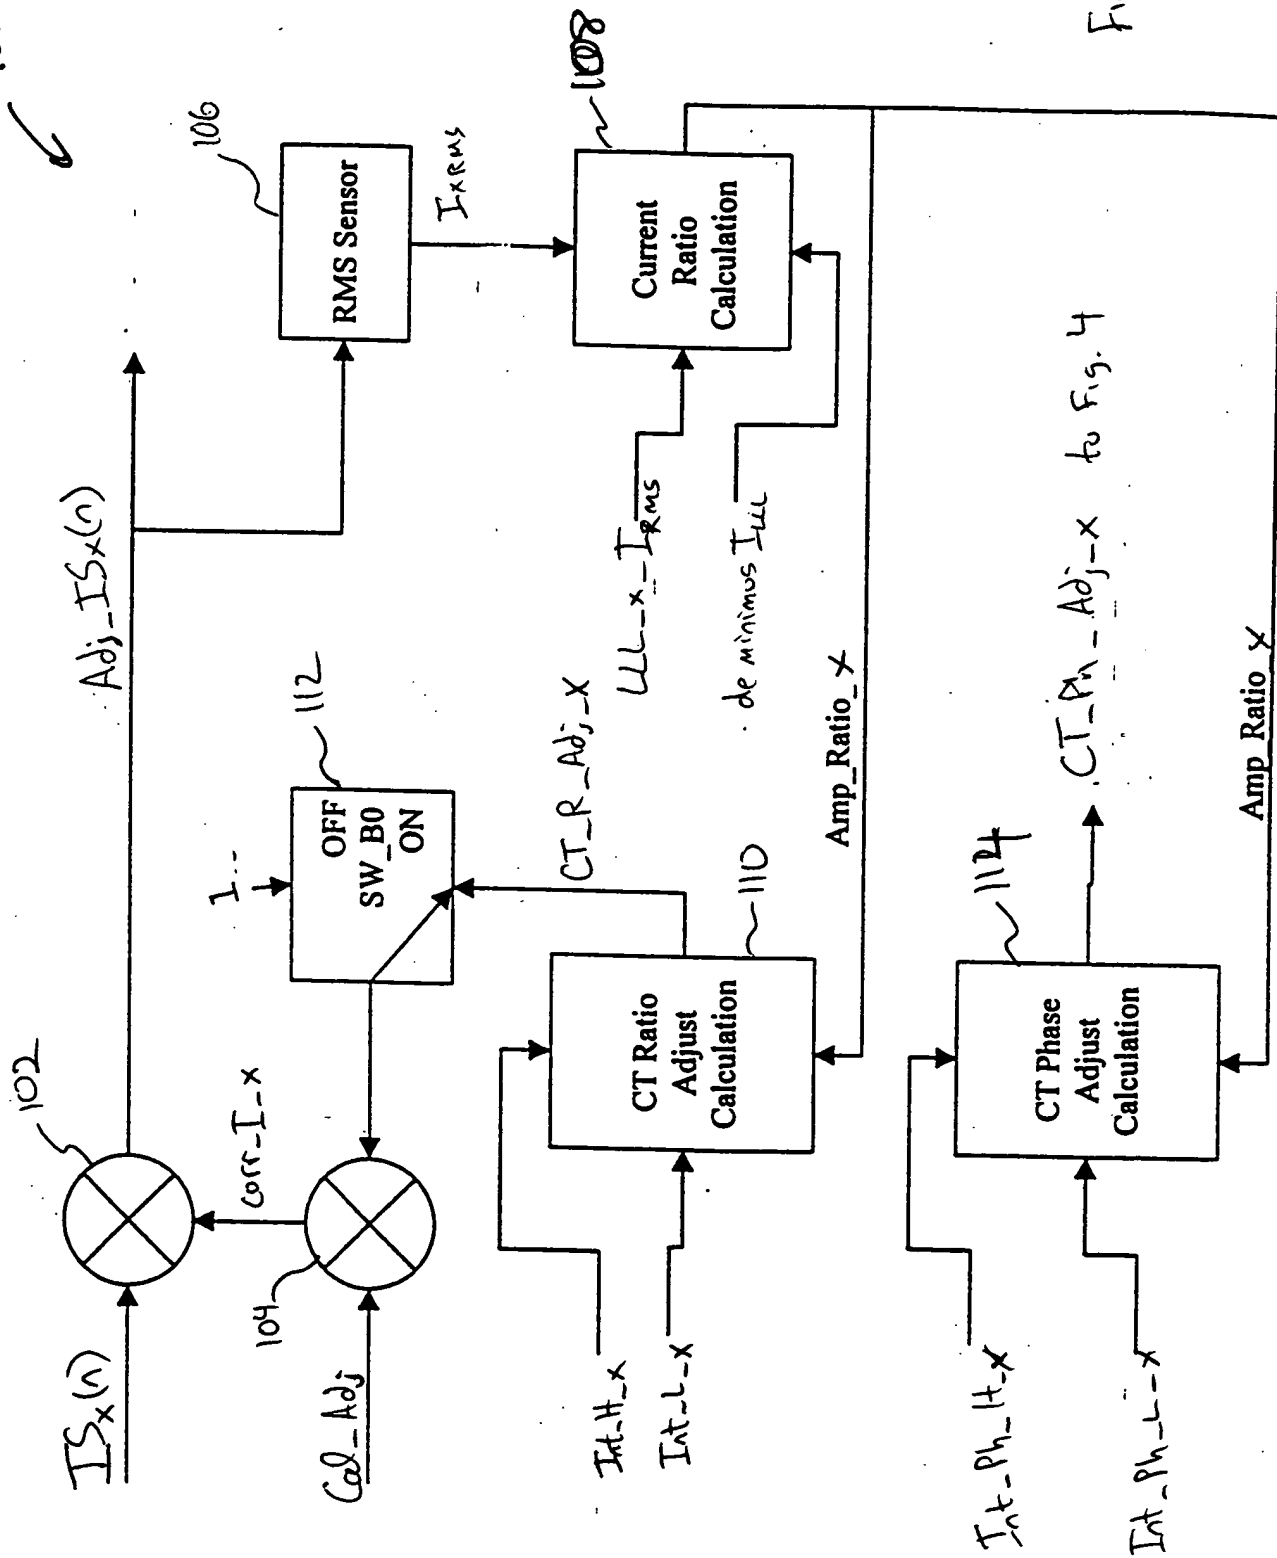


FIG. 3

Voltage Channel Inst. Xfmr Correction

200


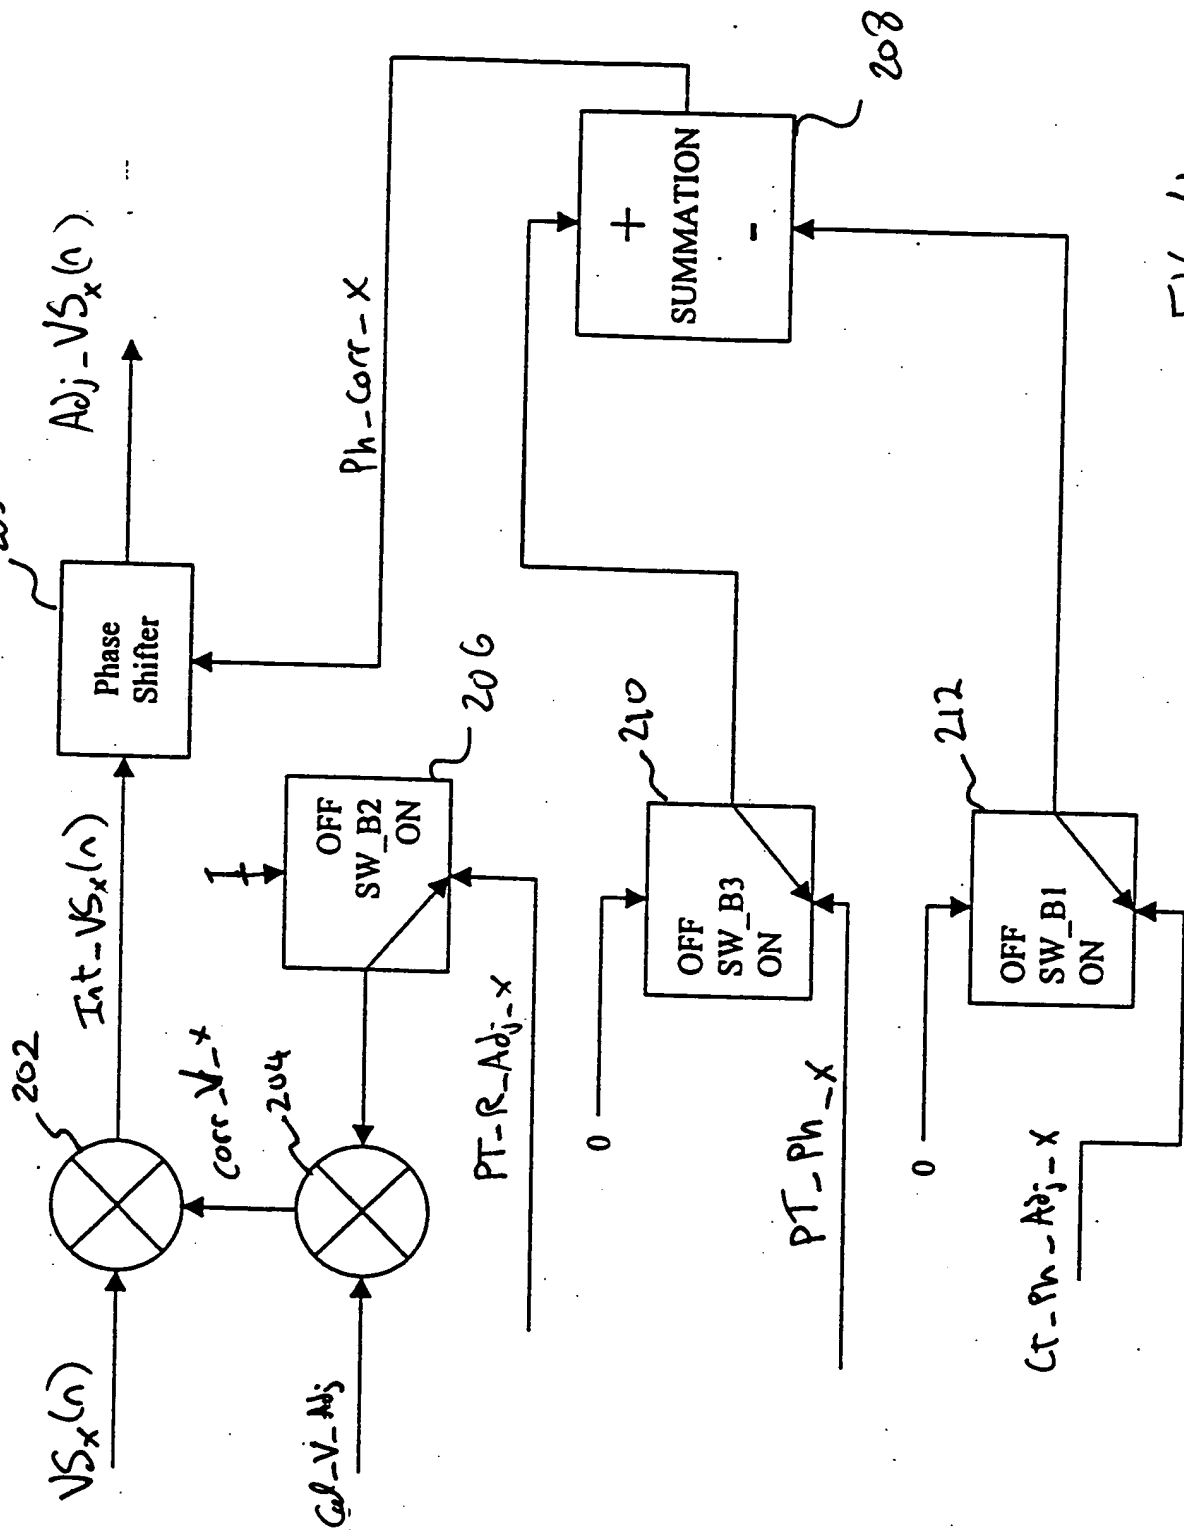


FIG. 4

FIG. 5

15KV CURRENT TRANSFORMER

400 AMPS

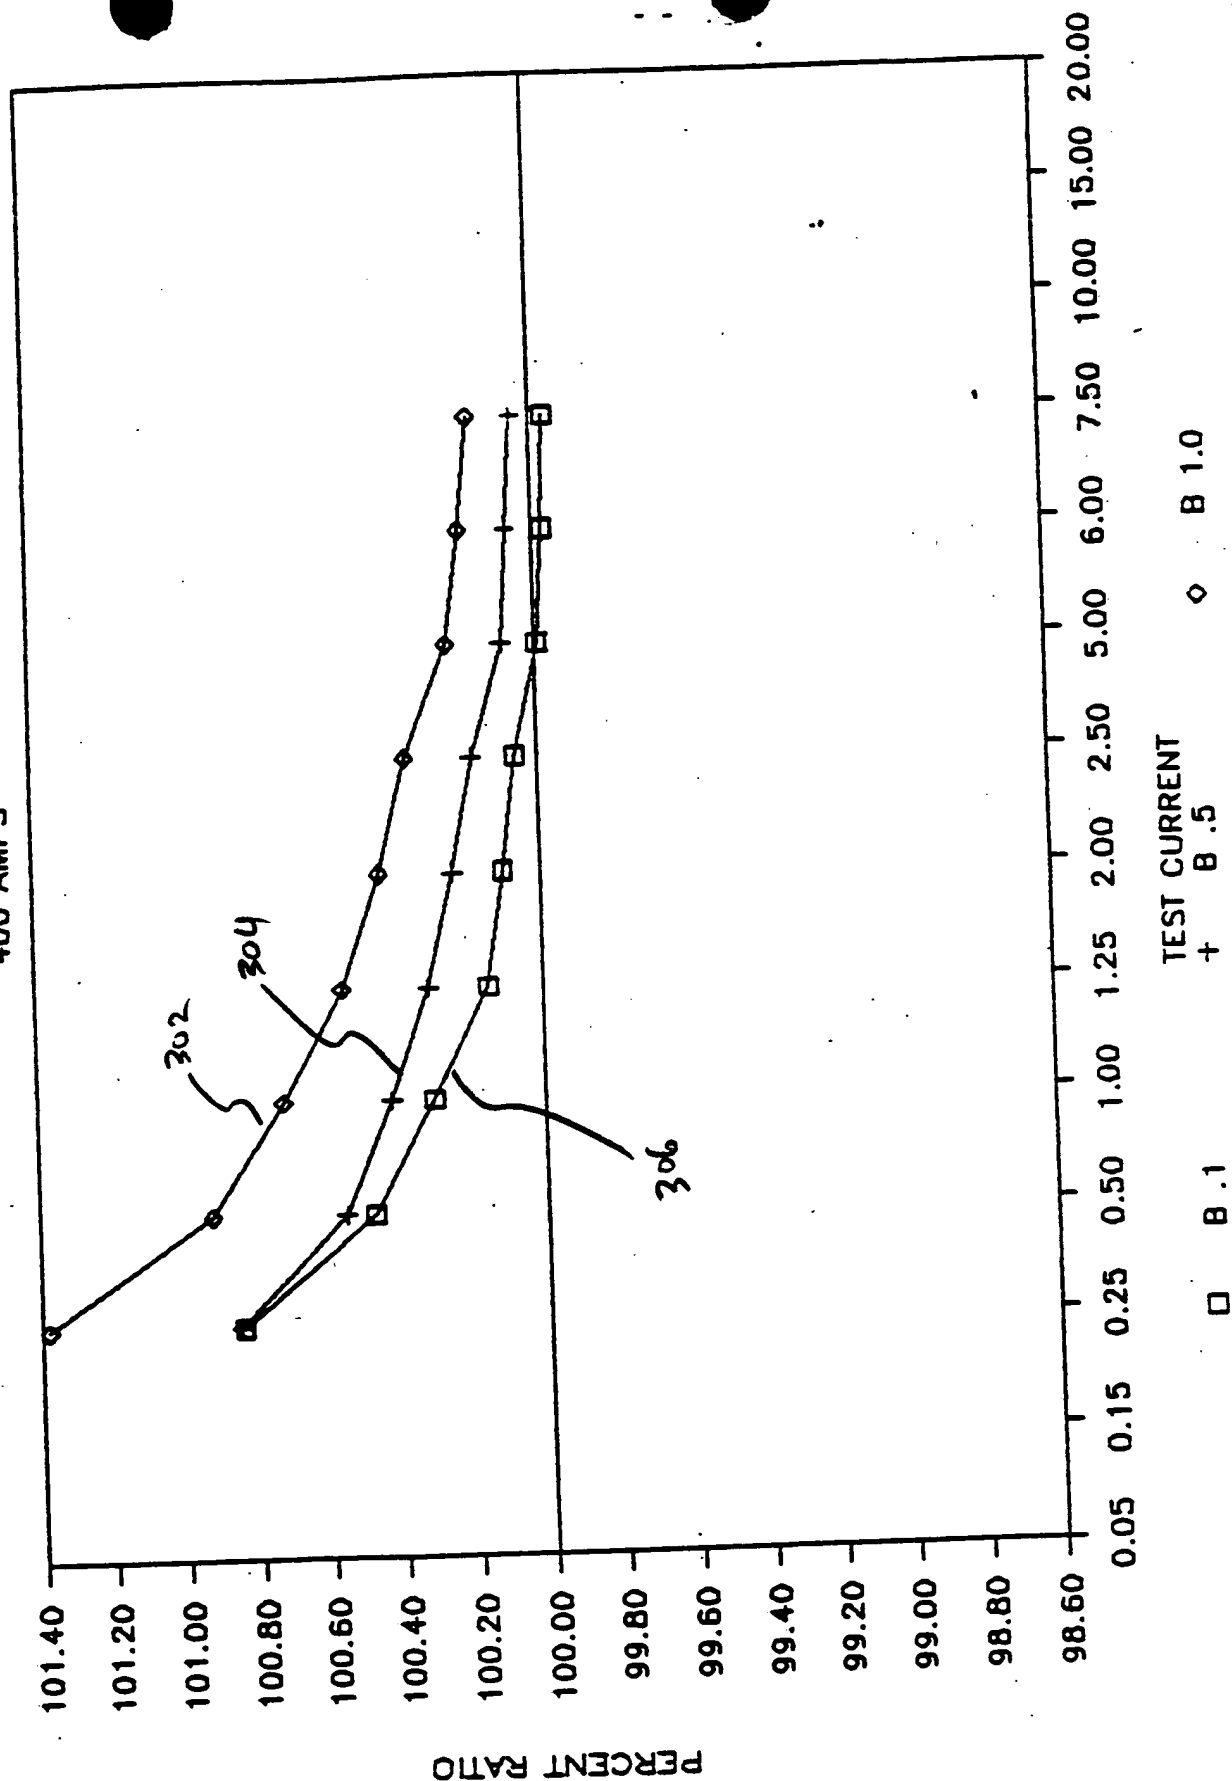

250

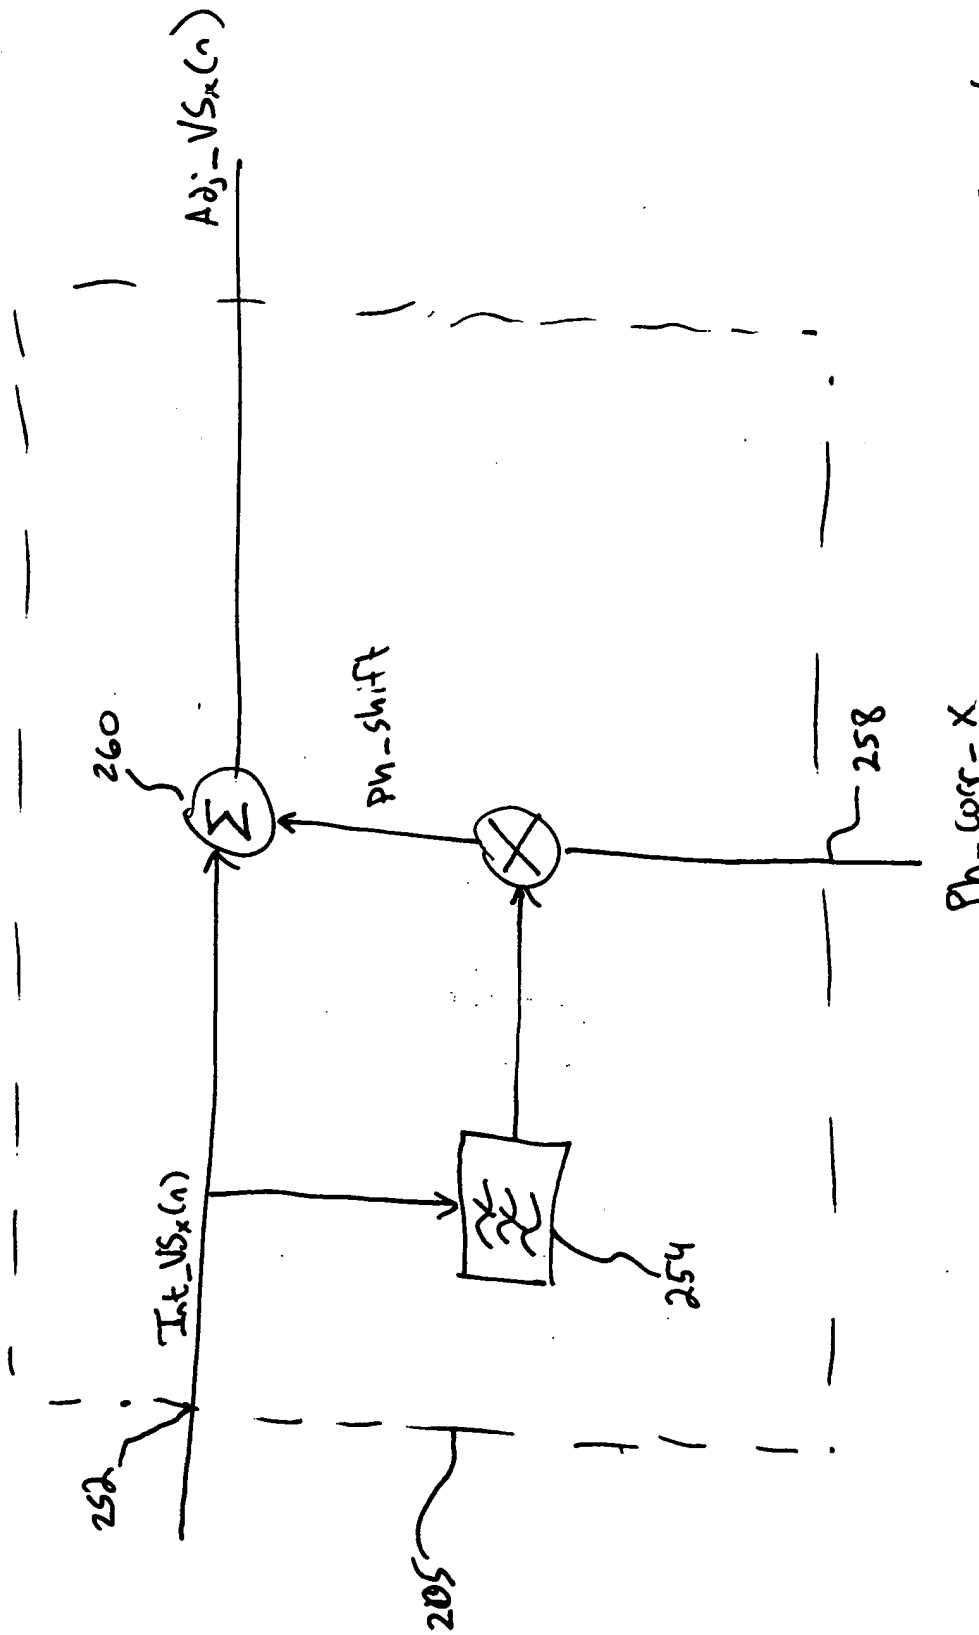


Fig. 6